



PLAN VIEW
Type I Ramp




24" Min. from Back of Curb Line & width of ramp should be colored (red) brick with truncated domes or cast in place detectable warning mats (composite panels - brick red).

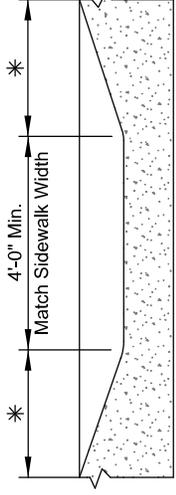


* Variable - Consult Public Works Department for Dimensions.

SECTION A-A

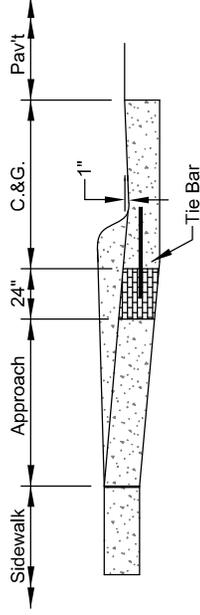

SECTION B-B

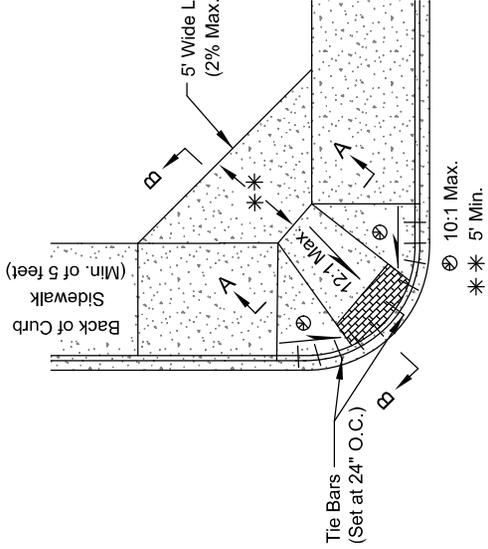

PLAN VIEW
Type III Ramp

SIDEWALK RAMP REQUIREMENTS

1. Where possible, ramp & gutter should be monolithic pour. Tie bars not required on monolithic pour.
2. The maximum ramp slope is 1" per foot. any deviation must be approved by the Public Works Department.
3. The normal gutter flowline profile shall be maintained through the ramp area.
4. Consult the Public Works Department for specific applications and for approval of alternate ramp types.
5. The concrete depth will be a minimum of 6" in residential areas. A minimum of 8" is to be used on collector and arterial streets.
6. Use 3/4" isolation jt. for 6" or thicker, use 1/2" isolation jt. for under 6" thick.

CITY OF GARDEN CITY, KANSAS
PUBLIC WORKS DEPARTMENT

SIDEWALK HANDICAP RAMP

Revisions:

Date:	JUNE 2017
Dr. No.:	11-6